


TOP VIEW

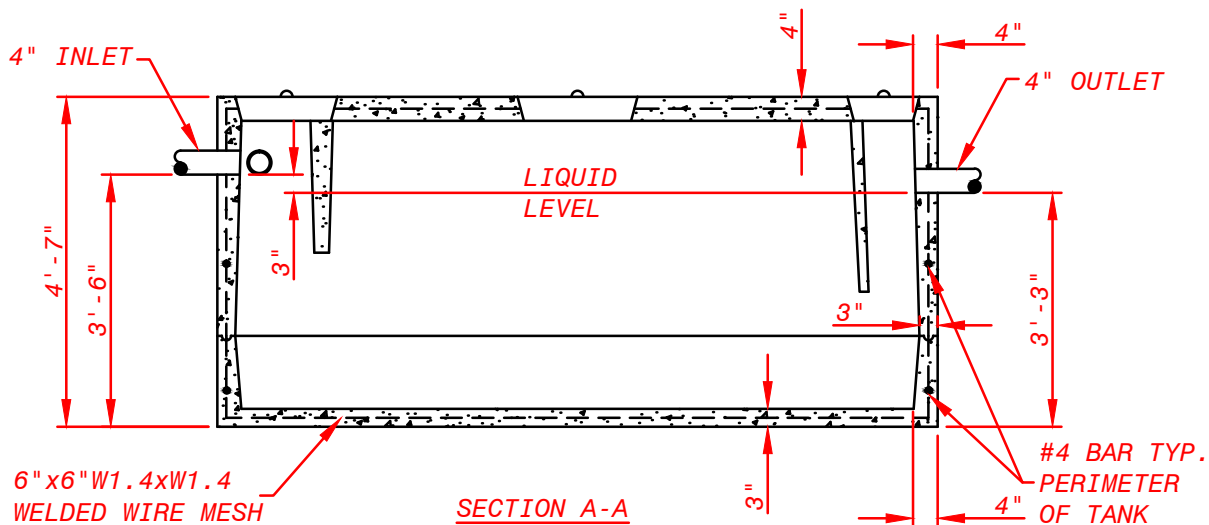

SECTION A-A

DESIGN NOTES:

1. MINIMUM COMPRESSIVE STRENGTH = 4000 PSI @ 28 DAYS
2. INLET BAFFLE AND OUTLET CHAMBER ARE PRECAST AS ONE UNIT WITH TOP SECTION OF THE SEPTIC TANK
3. KEYED JOINTS SEALED WITH BUTYL MASTIC SEALANT
4. EXCAVATION MUST BE AT LEAST 12" WIDER AND LONGER THAN TANK
5. OPTIONAL HEAVY DUTY SEPTIC TANKS FOR DRIVEWAYS, TOPS REINFORCED WITH #4 BAR @ 12" OC EACH WAY

Aroosta Cast, Inc

217 Parsons Road
 Presque Isle, ME 04769

Tel/Fax: 207-764-0077 E-Mail: sales@aroostacast.com

DRAWING:

1000 GALLON LOW BOY
 SEPTIC TANK

SCALE: N.T.S.

PAGE 1 OF 1